


Standard Duty Beam Clamp Fig. 133

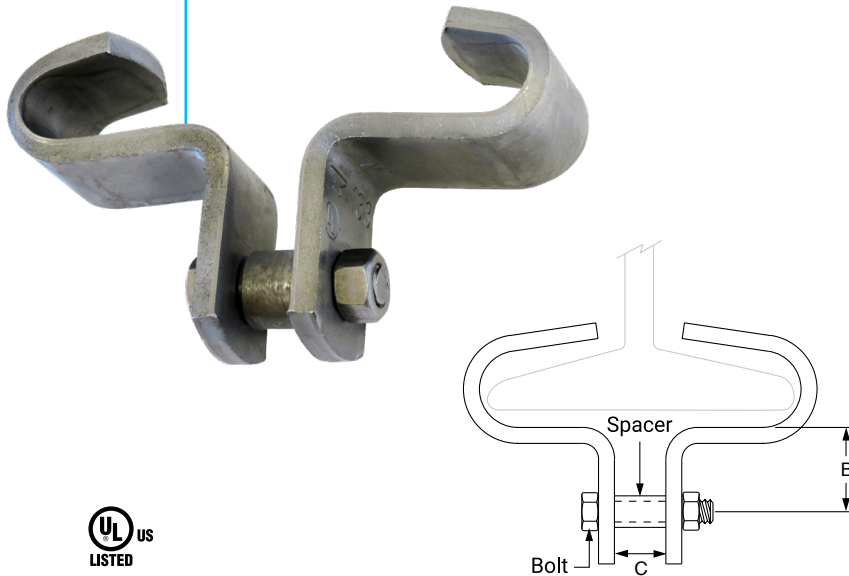

Dimensions (In) - Load (Lbs)

C	B	Bolt Size	Spacer O.D.	Max Load
In.	In.	In.	In.	Lbs.
9/16	1 3/8	3/8	1 1/16	1,000

Flange Size

Flange Width	Max Flange Thickness	Weight (Fig. 133 Std. Duty)
In.	In.	Lbs.
4	1/2	0.91
5	5/8	1.00
6	3/4	1.15
7	7/8	1.29
8		1.44

Material Specifications

Size Range
4" through 8"

Material
Carbon steel

Finish
Plain
Hot-Dip Galvanized with
Zinc Plated Fasteners

Service
Clamp centers the load on beam to prevent distortion.

Approvals
Complies with Federal Specification A-A-1192A (Type 21), WW-H-171-E (Type 21), ANSI/MSS SP-69 and MSS SP-58 (Type 21).
Fig. 133 UL Listed when used with 3/8" and 1/2" rod.

Components
Two half-clamps, pipe spacer and bolt with nut assembled.

Ordering
Figure number, width of flange, name and finish.

Note
Spacer is furnished for use with Fig. 290 weldless eye nuts.
Spacer may be removed for use with Fig. 278 eye rods.



PROJECT INFORMATION	APPROVAL STAMP
Project:	Approved
Address:	Approved as noted
Contractor:	Not approved
Engineer:	Remarks:
Submittal Date:	
Notes 1:	
Notes 2:	